


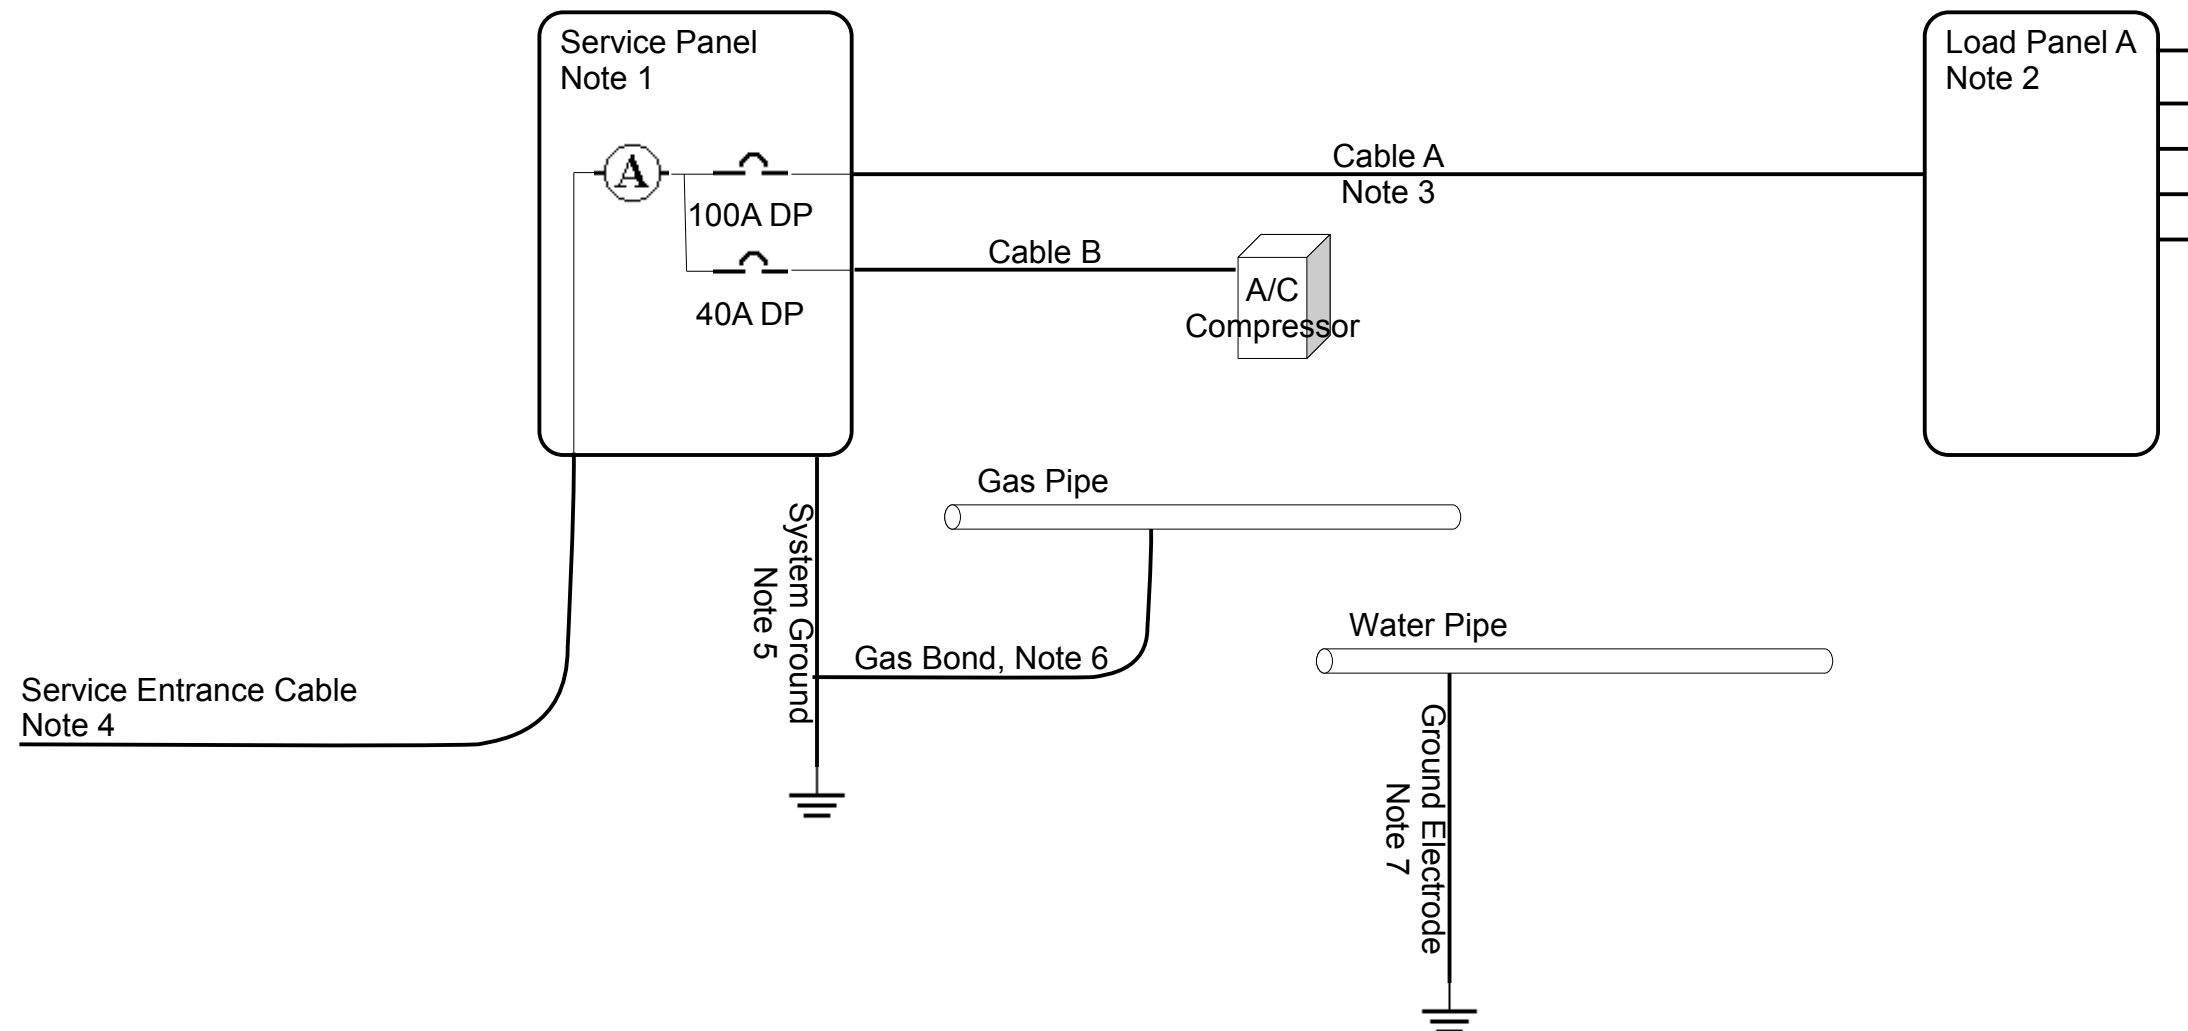

Notes:

- | | | |
|-------------------|--|------|
| 1. Service Panel, | Federal Pacific #UG2MX125SF | 125A |
| 2. Load Panel A, | Federal Pacific #L116-24GC | 125A |
| 3. Cable A | SER XHHW, 3 x AWG#1/0-AL, 1 x AWG#2-AL | |
| 4. SE Cable | 3 x AWG#1/0 | |
| 5. Sys Ground | AWG#4-CU to Foundation | |
| 6. Gas Bond | AWG#4-CU | |
| 7. Gnd Electrode | CU Water Pipe, underground below slab. No wire bond. | |

Project: <address>
Permit: <permit number>

Existing Service and Distribution
Revision 1, Page 1 of 3
7/26/2011